



**BOL CABLE RAILING SYSTEM  
IBC 2021 AND IRC 2021**

**8/22/2024**

**JACEK SLUZYNSKI, P.E.  
BARRETTE OUTDOOR LIVING  
2401 CORPORATE BLVD • BROOKSVILLE, FL 34604  
(352) 754-8555**



Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024




Jacek Sluzynski  
8/22/2024

Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License No. 54659, Expiration Date: 7/11/2025



Jacek Sluzynski  
8/22/2024

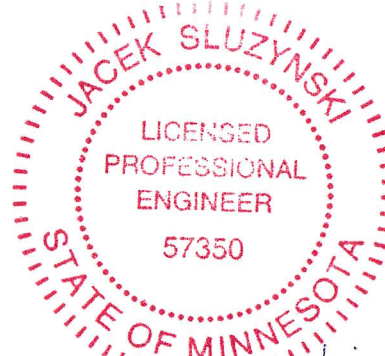

Jacek Sluzynski  
8/22/2024

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the state of Minnesota.

Signature: Jacek Sluzynski  
Typed or Printed Name: JACEK SLUZYSKI  
Date: 8/22/2024 License Number: 57350



Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024




Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024




Jacek Sluzynski  
8/22/2024

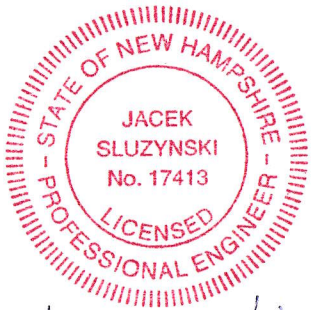

Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024

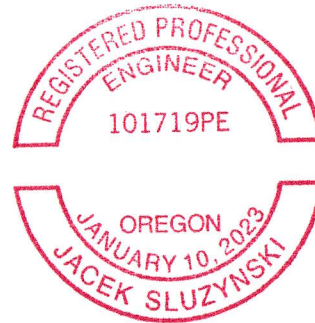

EXPIRES: 06/30/2026  
Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024



Jacek Sluzynski  
8/22/2024




Jacek Sluzynski  
8/22/2024

## **GENERAL NOTES**

1. The "Cable Railing" (*guard*) meets or exceeds 2021 International Building Code (IBC) section 1607.8. and 2021 International Residential Code (IRC) section R301.5.
2. Loads:
  - 2.1. The top railing of the guard is capable of transferring to the anchoring connection a point load of 200 pounds (Residential applications) and 200 pounds or 50 pounds per linear foot (Commercial applications) applied in any direction.
  - 2.2. The infill (cable) are capable of transferring to the anchoring connection a horizontally applied normal load of 50 pounds exerted over 1 square foot.
3. The professional engineer (PE) is responsible for the design of the *guard* to the bottom of the base plate, to the bottom of the post, and to the mounting surface of the upper and lower railing wall brackets. The PE is not responsible for the design of the anchoring substrate, such as, concrete or wood. Except for the fasteners specified, the PE is not responsible for the selection or location of the anchoring fasteners.
4. The use of this specification indemnifies and saves harmless the PE from all cost and damages including legal fees and appellate fees resulting from material and part fabrication, manufacturing, assembly, system design and erection, construction practices, and Barrette warranties. Neither the PE nor Barrette shall be held responsible or liable in any way for the use of this product in applications other than shown on this drawing.
5. Materials and manufacturing of the guard shall be in accordance with the Aluminum Association's 2015 "Aluminum Design Manual".
6. All *guard* extrusions shall be aluminum 6005-T5. Cables and brackets 316 SS.
7. All *guard* fasteners are 410 stainless steel.
8. Barrette manufacturing tolerances for the guard are equal to or tighter than allowed by the IBC and IRC. Contact Barrette for specific tolerances.
9. All concrete shall be uncracked only, with a minimum compressive strength of 3000psi and shall be minimum 1.5X thicker than any anchor embedment. All epoxy and grout shall meet or exceed compressive strength of the concrete and shall be iron-free, non-shrink and non-reactive. Concrete footers shall contain min 0.1% fiber mesh admixture per CY.
10. All wood shall be pressure treated No. 2 Southern Yellow Pine with minimum specific gravity, G=0.55


11. Surrounding soil to be compacted to 98% optimum density, 2500 psf minimum and
12. Insulate aluminum from dissimilar metals to prevent electrolysis. Insure all bare metal is protected from corrosive environments such as installation near the ocean.
13. Neither the PE nor Barrette is responsible for construction tolerances, field dimensions, or installation of the *guard*.
14. No changes are allowed without written authorization from the engineer.
15. Copies of this drawing without an original signature and seal of the engineer are invalid.
16. No inspection was made at this jobsite and the design depicted herein is based upon data supplied by the contractor. This engineer is to not be held liable or in any way responsible for the use of any inaccurate information supplied by others. The contractor shall field verify all measurements and information used in this design before any changes are made to field condition, fabrication and the installation of the materials.

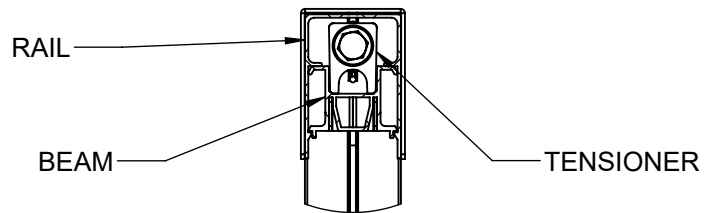



# ELEVATION RAIL DETAILS

DETAIL C  
SCALE 1 : 4

Ø.125" CABLE  
7X7 WIRE  
CONFIGURATION



DETAIL B  
SCALE 1 : 4

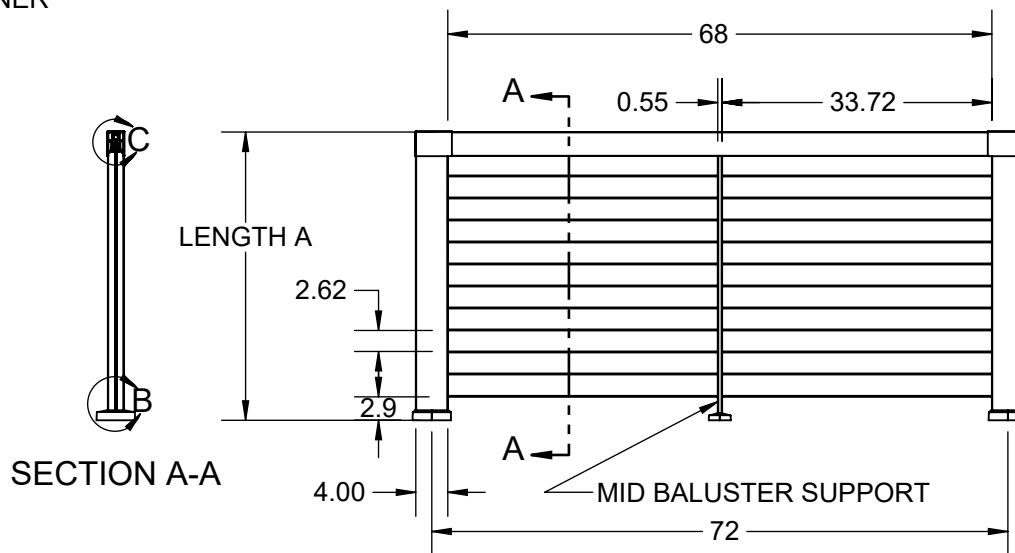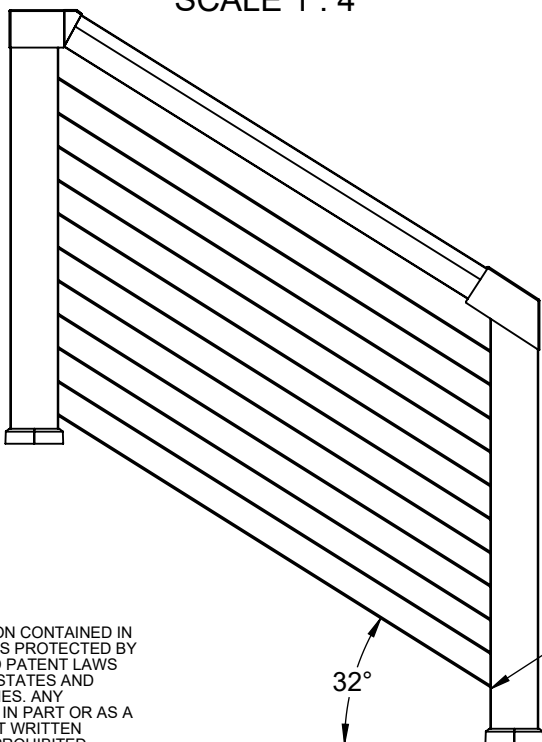

NOTE:

- (A) FINISHED RAIL HEIGHT = 36", 42"
- (B) PANEL LENGTH = 68"
- (C) MAX IRC SPAN = 72"X36"
- (D) MAX IBC SPAN = 72"X42"
- (E) TENSION CABLE TO PREVENT PASSING 4" SPHERE

NOTE:

- (A) MAX STAIR RAIL LENGTH = 60"
  - (B) STAIRS AVAILABLE IN 36" AND 42" RAIL HEIGHTS
  - (C) TENSION CABLE TO PREVENT PASSING 4" SPHERE
- STAIR SECTIONS HAVE A WORKING RANGE OF 26-38 DEGREES


THE INFORMATION CONTAINED IN THIS DRAWING IS PROTECTED BY COPYRIGHT AND PATENT LAWS OF THE UNITED STATES AND OTHER COUNTRIES. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT WRITTEN PERMISSION IS PROHIBITED.




DRAWN: CH	DATE: 08/22/2024	APPROVED:
DESCRIPTION: ELEVATION LEVEL AND STAIR RAIL		
SHEET 1 OF 7	REVISION	PART NUMBER
SCALE 1:24	0	N/A
WEIGHT: N/A		

# POSTS AND RAILS


CORNER

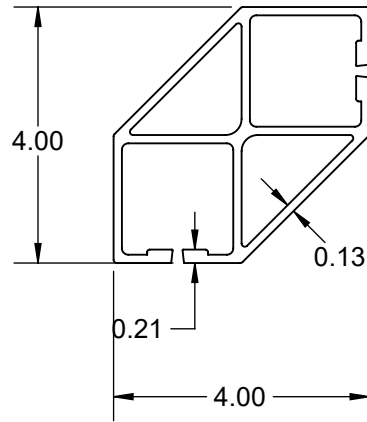


END

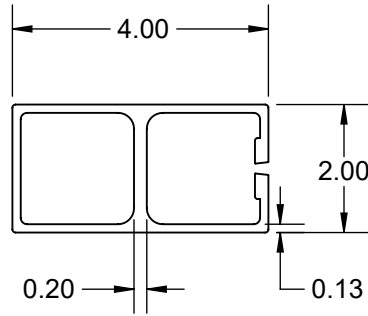


MID

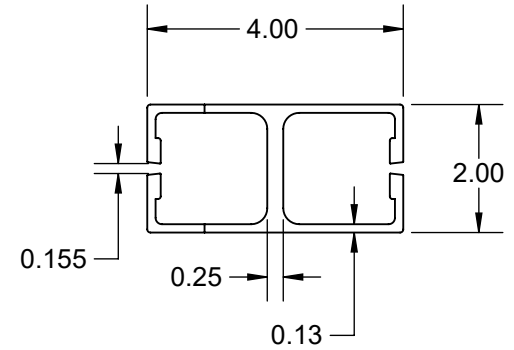

BEAM

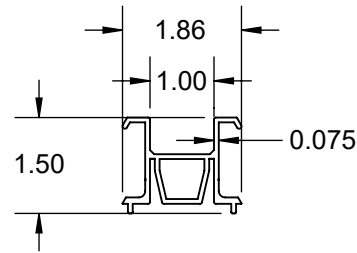





RAIL

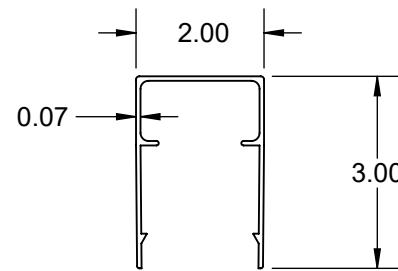

THE INFORMATION CONTAINED IN THIS DRAWING IS PROTECTED BY COPYRIGHT AND PATENT LAWS OF THE UNITED STATES AND OTHER COUNTRIES. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT WRITTEN PERMISSION IS PROHIBITED.

<b>Barrette</b> OUTDOOR LIVING		
DRAWN: CH	DATE: 08/22/2024	APPROVED:
DESCRIPTION: <b>POST AND RAIL DETAILS</b>		
SHEET 2 OF 7	REVISION	PART NUMBER
SCALE 1:12		N/A
WEIGHT: N/A		

## SURFACE MOUNT DETAILS

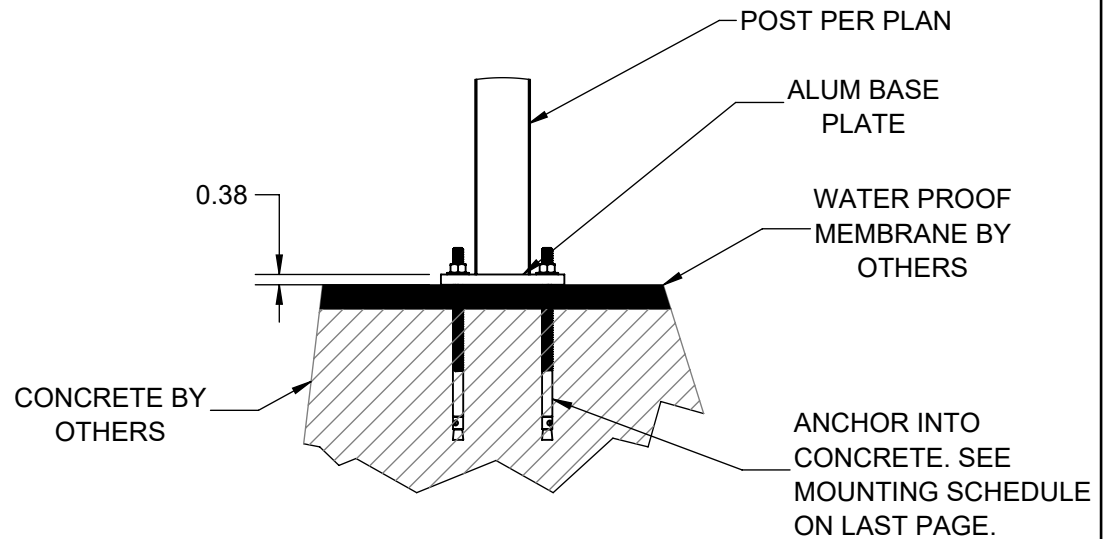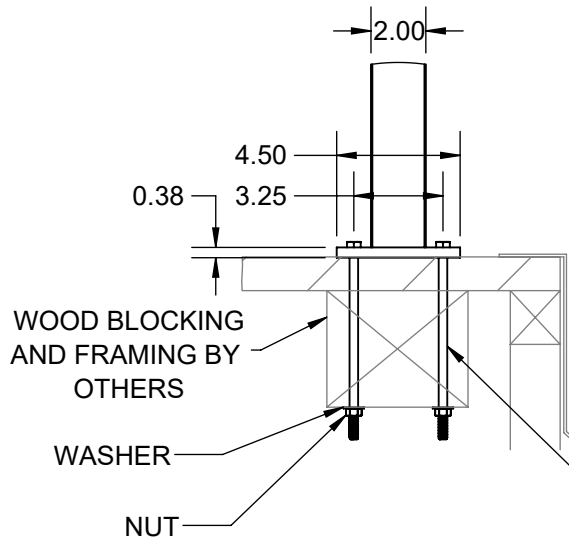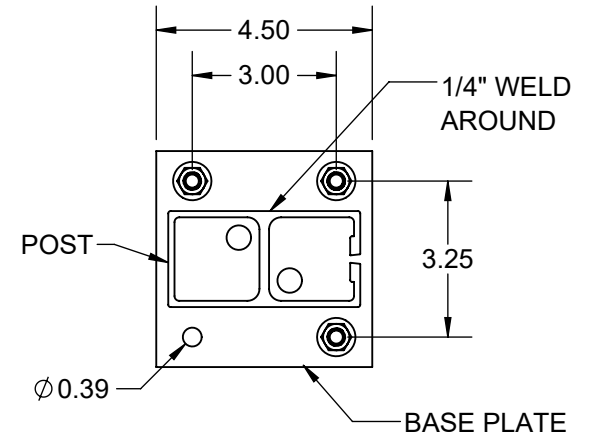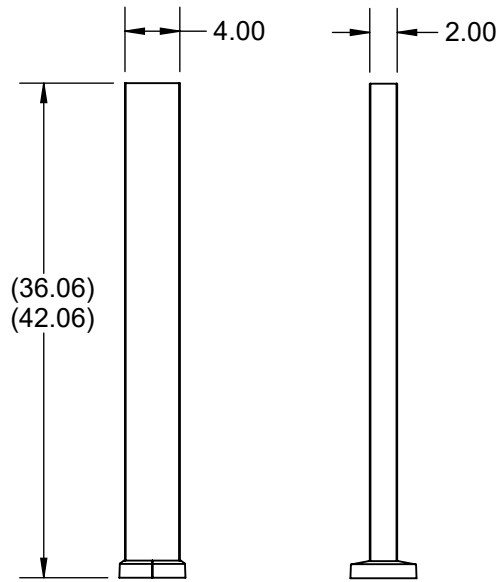


3/8" DIAMETER THROUGH BOLTS INTO SOLID WOOD .  
SEE MOUNTING SCHEDULE ON LAST PAGE.

THE INFORMATION CONTAINED IN THIS DRAWING IS PROTECTED BY COPYRIGHT AND PATENT LAWS OF THE UNITED STATES AND OTHER COUNTRIES. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT WRITTEN PERMISSION IS PROHIBITED.

<b>Barrette</b> OUTDOOR LIVING		
DRAWN: CH	DATE: 08/22/2024	APPROVED:
DESCRIPTION: <b>SURFACE MOUNT DETAILS</b>		
SHEET 3 OF 7	REVISION	PART NUMBER
SCALE 1:1		<b>N/A</b>
WEIGHT: N/A		

## SURFACE MOUNT DETAILS

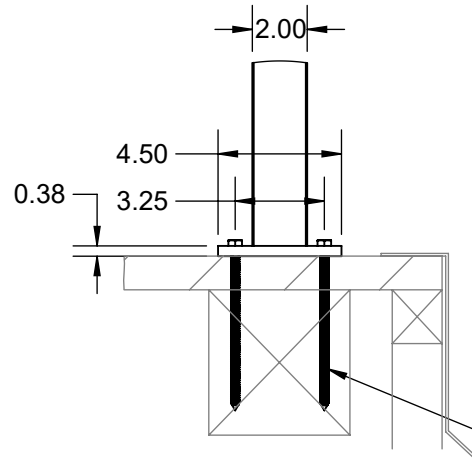


4 LAG BOLTS INTO SOLID WOOD 3/8" DIAMETER MINIMUM. SEE MOUNTING SCHEDULE ON LAST PAGE

THE INFORMATION CONTAINED IN THIS DRAWING IS PROTECTED BY COPYRIGHT AND PATENT LAWS OF THE UNITED STATES AND OTHER COUNTRIES. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT WRITTEN PERMISSION IS PROHIBITED.



<b>Barrette</b> OUTDOOR LIVING		
DRAWN: CH	DATE: 08/22/2024	APPROVED:
DESCRIPTION: <b>SURFACE MOUNT DETAILS</b>		
SHEET 4 OF 7	REVISION	PART NUMBER
SCALE 1:1		<b>N/A</b>
WEIGHT: N/A		

# BRACKETS & ACCESSORIES


## LEVEL CABLE GUIDES

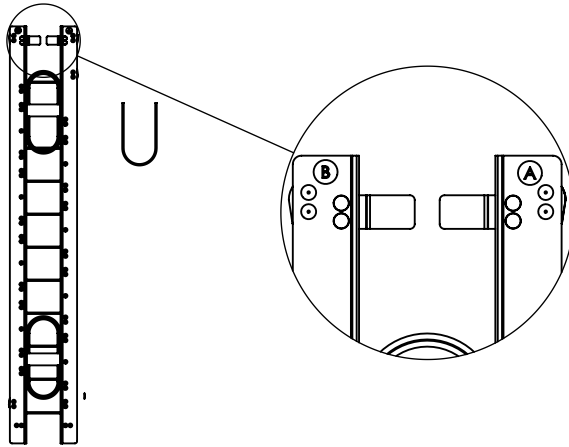

## STAIR CABLE GUIDES

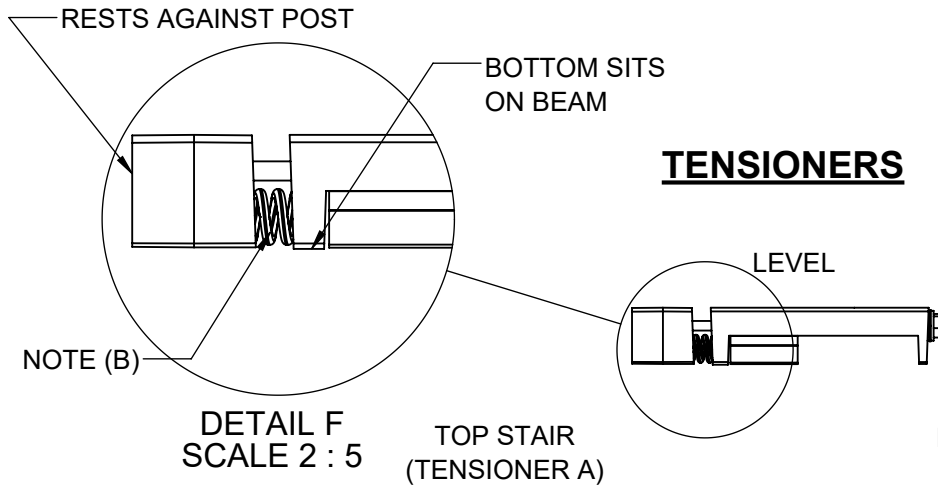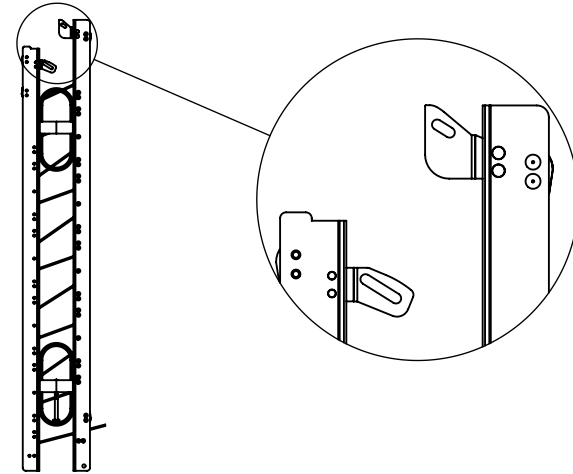



NOTE:  
 (A) 9/16" SOCKET OR WRENCH USED TO TURN BOLT TO TENSION CABLES  
 (B) SPRING WILL COMPRESS AND SPACE WILL CLOSE ONCE 250LB LIMIT IS REACHED



DETAIL F  
SCALE 2 : 5

TOP STAIR  
(TENSIONER A)

BOTTOM STAIR  
(TENSIONER B)




THE INFORMATION CONTAINED IN THIS DRAWING IS PROTECTED BY COPYRIGHT AND PATENT LAWS OF THE UNITED STATES AND OTHER COUNTRIES. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT WRITTEN PERMISSION IS PROHIBITED.

<b>Barrette</b> OUTDOOR LIVING		
DRAWN: CH	DATE: 08/22/2024	APPROVED:
DESCRIPTION: <b>BRACKETS &amp; ACCESSORIES</b>		
SHEET 5 OF 7	REVISION	PART NUMBER
SCALE 1:2		<b>N/A</b>
WEIGHT: N/A		


# BRACKETS & ACCESSORIES

## POST CAPS


LEVEL LINE CAP

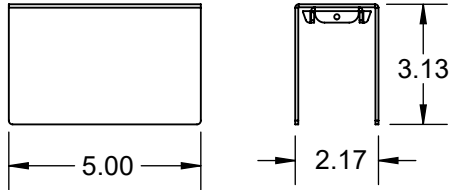


LEVEL END CAP

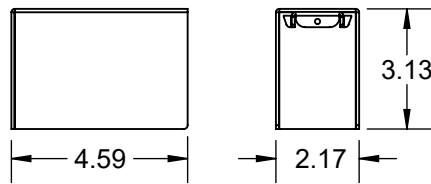


STAIR LINE CAP

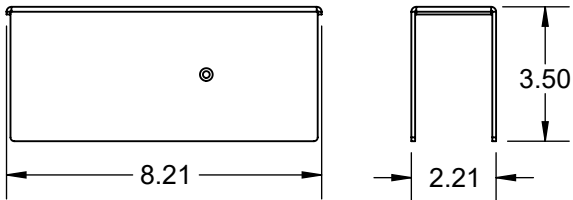


STAIR END CAP

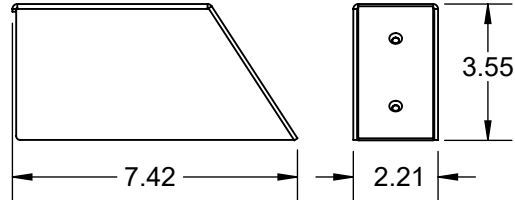

CORNER CAP


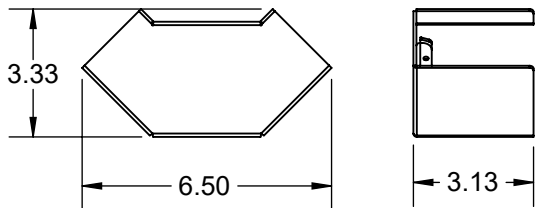


STAIR ADAPTER


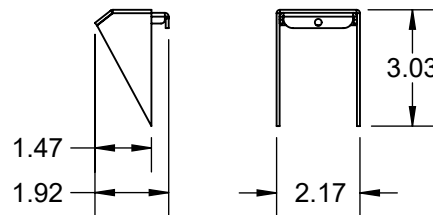


## POST TRIMS

LINE & END POST TRIM RING

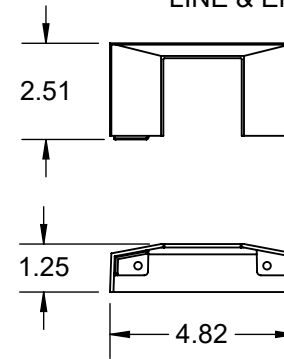

CORNER POST TRIM RING

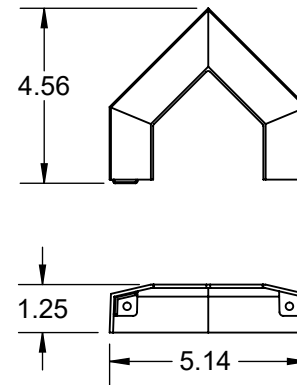

THE INFORMATION CONTAINED IN THIS DRAWING IS PROTECTED BY COPYRIGHT AND PATENT LAWS OF THE UNITED STATES AND OTHER COUNTRIES. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT WRITTEN PERMISSION IS PROHIBITED.


<b>Barrette</b> OUTDOOR LIVING		
DRAWN: CH	DATE: 08/22/2024	APPROVED:
DESCRIPTION: <b>BRACKETS &amp; ACCESSORIES</b>		
SHEET 6 OF 7	REVISION	PART NUMBER
SCALE 1:5		<b>N/A</b>
WEIGHT: N/A		

## MOUNTING SCHEDULE

FOR RESIDENTIAL APPLICATIONS 36" HIGH					
PANEL WIDTH	LOAD	RECOMMENDED BOLT APPLICATION	FOR LAG BOLT APPLICATION 3/8" DIA. SCREW. MINIMUM EMBEDDED SCREW THREAD LENGTH REQUIRED	FOR THROUGH BOLT APPLICATION	FOR CONCRETE ANCHOR APPLICATION 3/8" TITAN HD ANCHOR MINIMUM REQUIRED LENGTH (MINIMUM DISTANCE OF 4" FROM EDGE REQUIRED)
6FT	200LBS	LAG BOLT -OR- THROUGH BOLT -OR- CONCRETE ANCHOR	3IN	3/8" HEX BOLT 3/8" FLAT WASHER 3/8" LOCK WASHER 3/8" NUT	3IN
4FT			2.5IN		3IN

FOR COMMERCIAL APPLICATIONS 42" HIGH					
PANEL WIDTH	LOAD	RECOMMENDED BOLT APPLICATION	FOR LAG BOLT APPLICATION 3/8" DIA. SCREW. MINIMUM EMBEDDED SCREW THREAD LENGTH REQUIRED	FOR THROUGH BOLT APPLICATION	FOR CONCRETE ANCHOR APPLICATION 3/8" TITAN HD ANCHOR MINIMUM REQUIRED LENGTH (MINIMUM DISTANCE OF 4" FORM EDGE REQUIRED)
6FT	300LBS	LAG BOLT -OR- THROUGH BOLT -OR- CONCRETE ANCHOR	3IN	3/8" HEX BOLT 3/8" FLAT WASHER 3/8" LOCK WASHER 3/8" NUT	3IN
4FT	200LBS		2.5IN		3IN

THE INFORMATION CONTAINED IN THIS DRAWING IS PROTECTED BY COPYRIGHT AND PATENT LAWS OF THE UNITED STATES AND OTHER COUNTRIES. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT WRITTEN PERMISSION IS PROHIBITED.

			
DRAWN:	CH	DATE:	08/22/2024
APPROVED:			
DESCRIPTION: <b>MOUNTING SCHEDULE</b>			
SHEET 7 OF 7		REVISION	PART NUMBER
SCALE 1:1		0	<b>N/A</b>
WEIGHT: N/A			